


DIGITAL CHRONOTHERMOSTAT ACCESSORIES

Remote actuator for the receipt of the control signals of thermostats and programmable thermostats by radiofrequency or by wire (RS-485).


It has got 6 relay outputs to control until 6 zone valves; another relay for the connection to the pump automatically switches when at least one of the 6 outputs is active.

COMPONENTS

1. Container: 4 DIN modules
2. Signalling led:
 - green for power on
 - reds for the 6 zone outputs status
 - yellow for the pump output status
3. "Set" key for channels configuration
4. Trimmer to set the switching delay of the output 7 (circulator)
 - Power supply: 230Vac (-15% ÷ +10%) 50/60Hz
 - Relays capacity: 5A / 250Vac
 - Rx.Ant Antenna 433.92 MHz (supplied) with cable length 4.5 m
 - RS-485 serial output for the connection by wire to Athena programmable thermostat
 - Switching delay of relay 7 settable between 3 seconds and 5 minutes

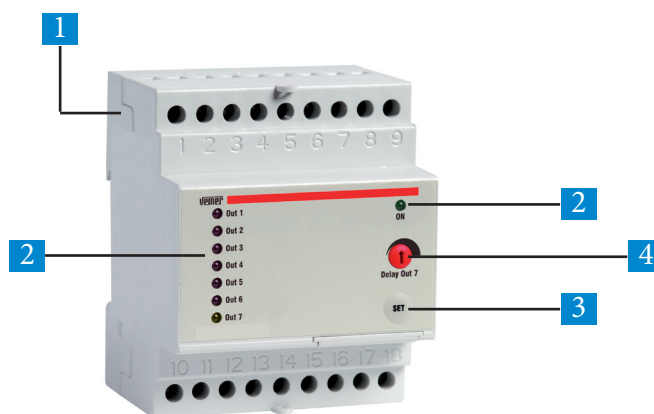

DIMENSIONS AND CONNECTION DIAGRAM

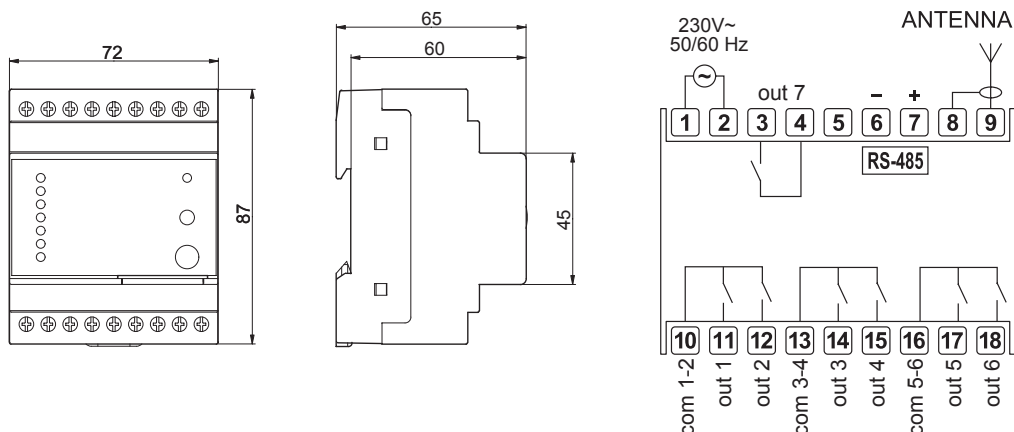

REFERENCE STANDARD

Compliance with Community Directives: 2006/95/EC (Low Voltage) and 2004/108/EC (E.M.C.) is declared with reference to the following Harmonized Standards: • EN 60730-1, EN 301 489-1/3 and EN 300 220-1/2