
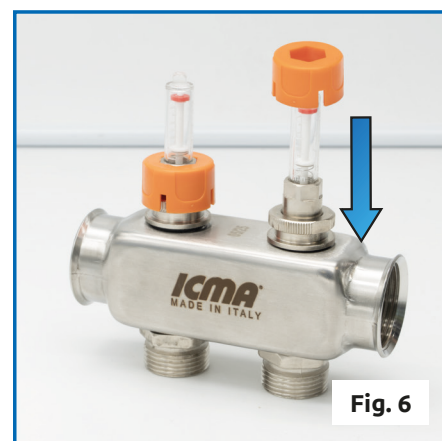
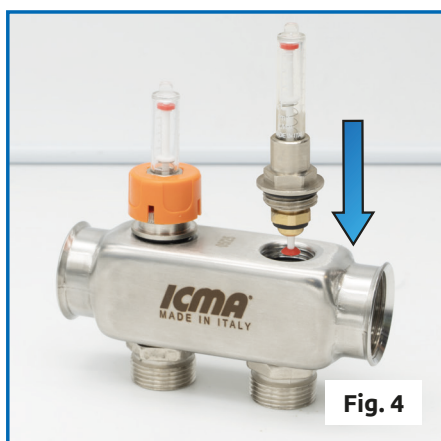
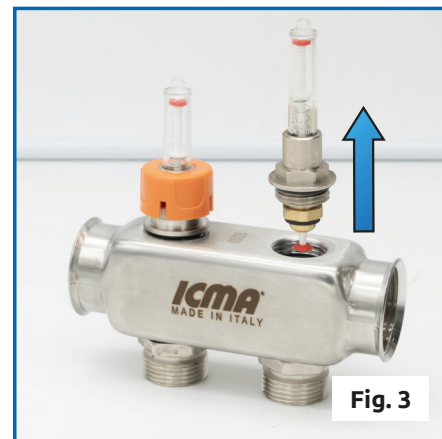


Instructions for replacing MEMORY PLUS flow meters for underfloor heating manifolds

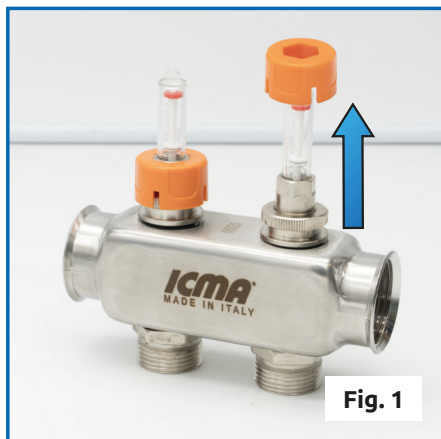

The manifold must be shut off if the work is carried out whilst the manifold is connected to a heating system

⚠ Important: always wear protective gloves during all operations.

1. Using a **23 mm** spanner, remove the flow meters, first taking off the plastic cover as shown in **Fig. 1**, and then replace them as shown in **Figs. 2-3**;
2. Next, refit the flow meter and replace the cover as shown in **Fig. 6**.